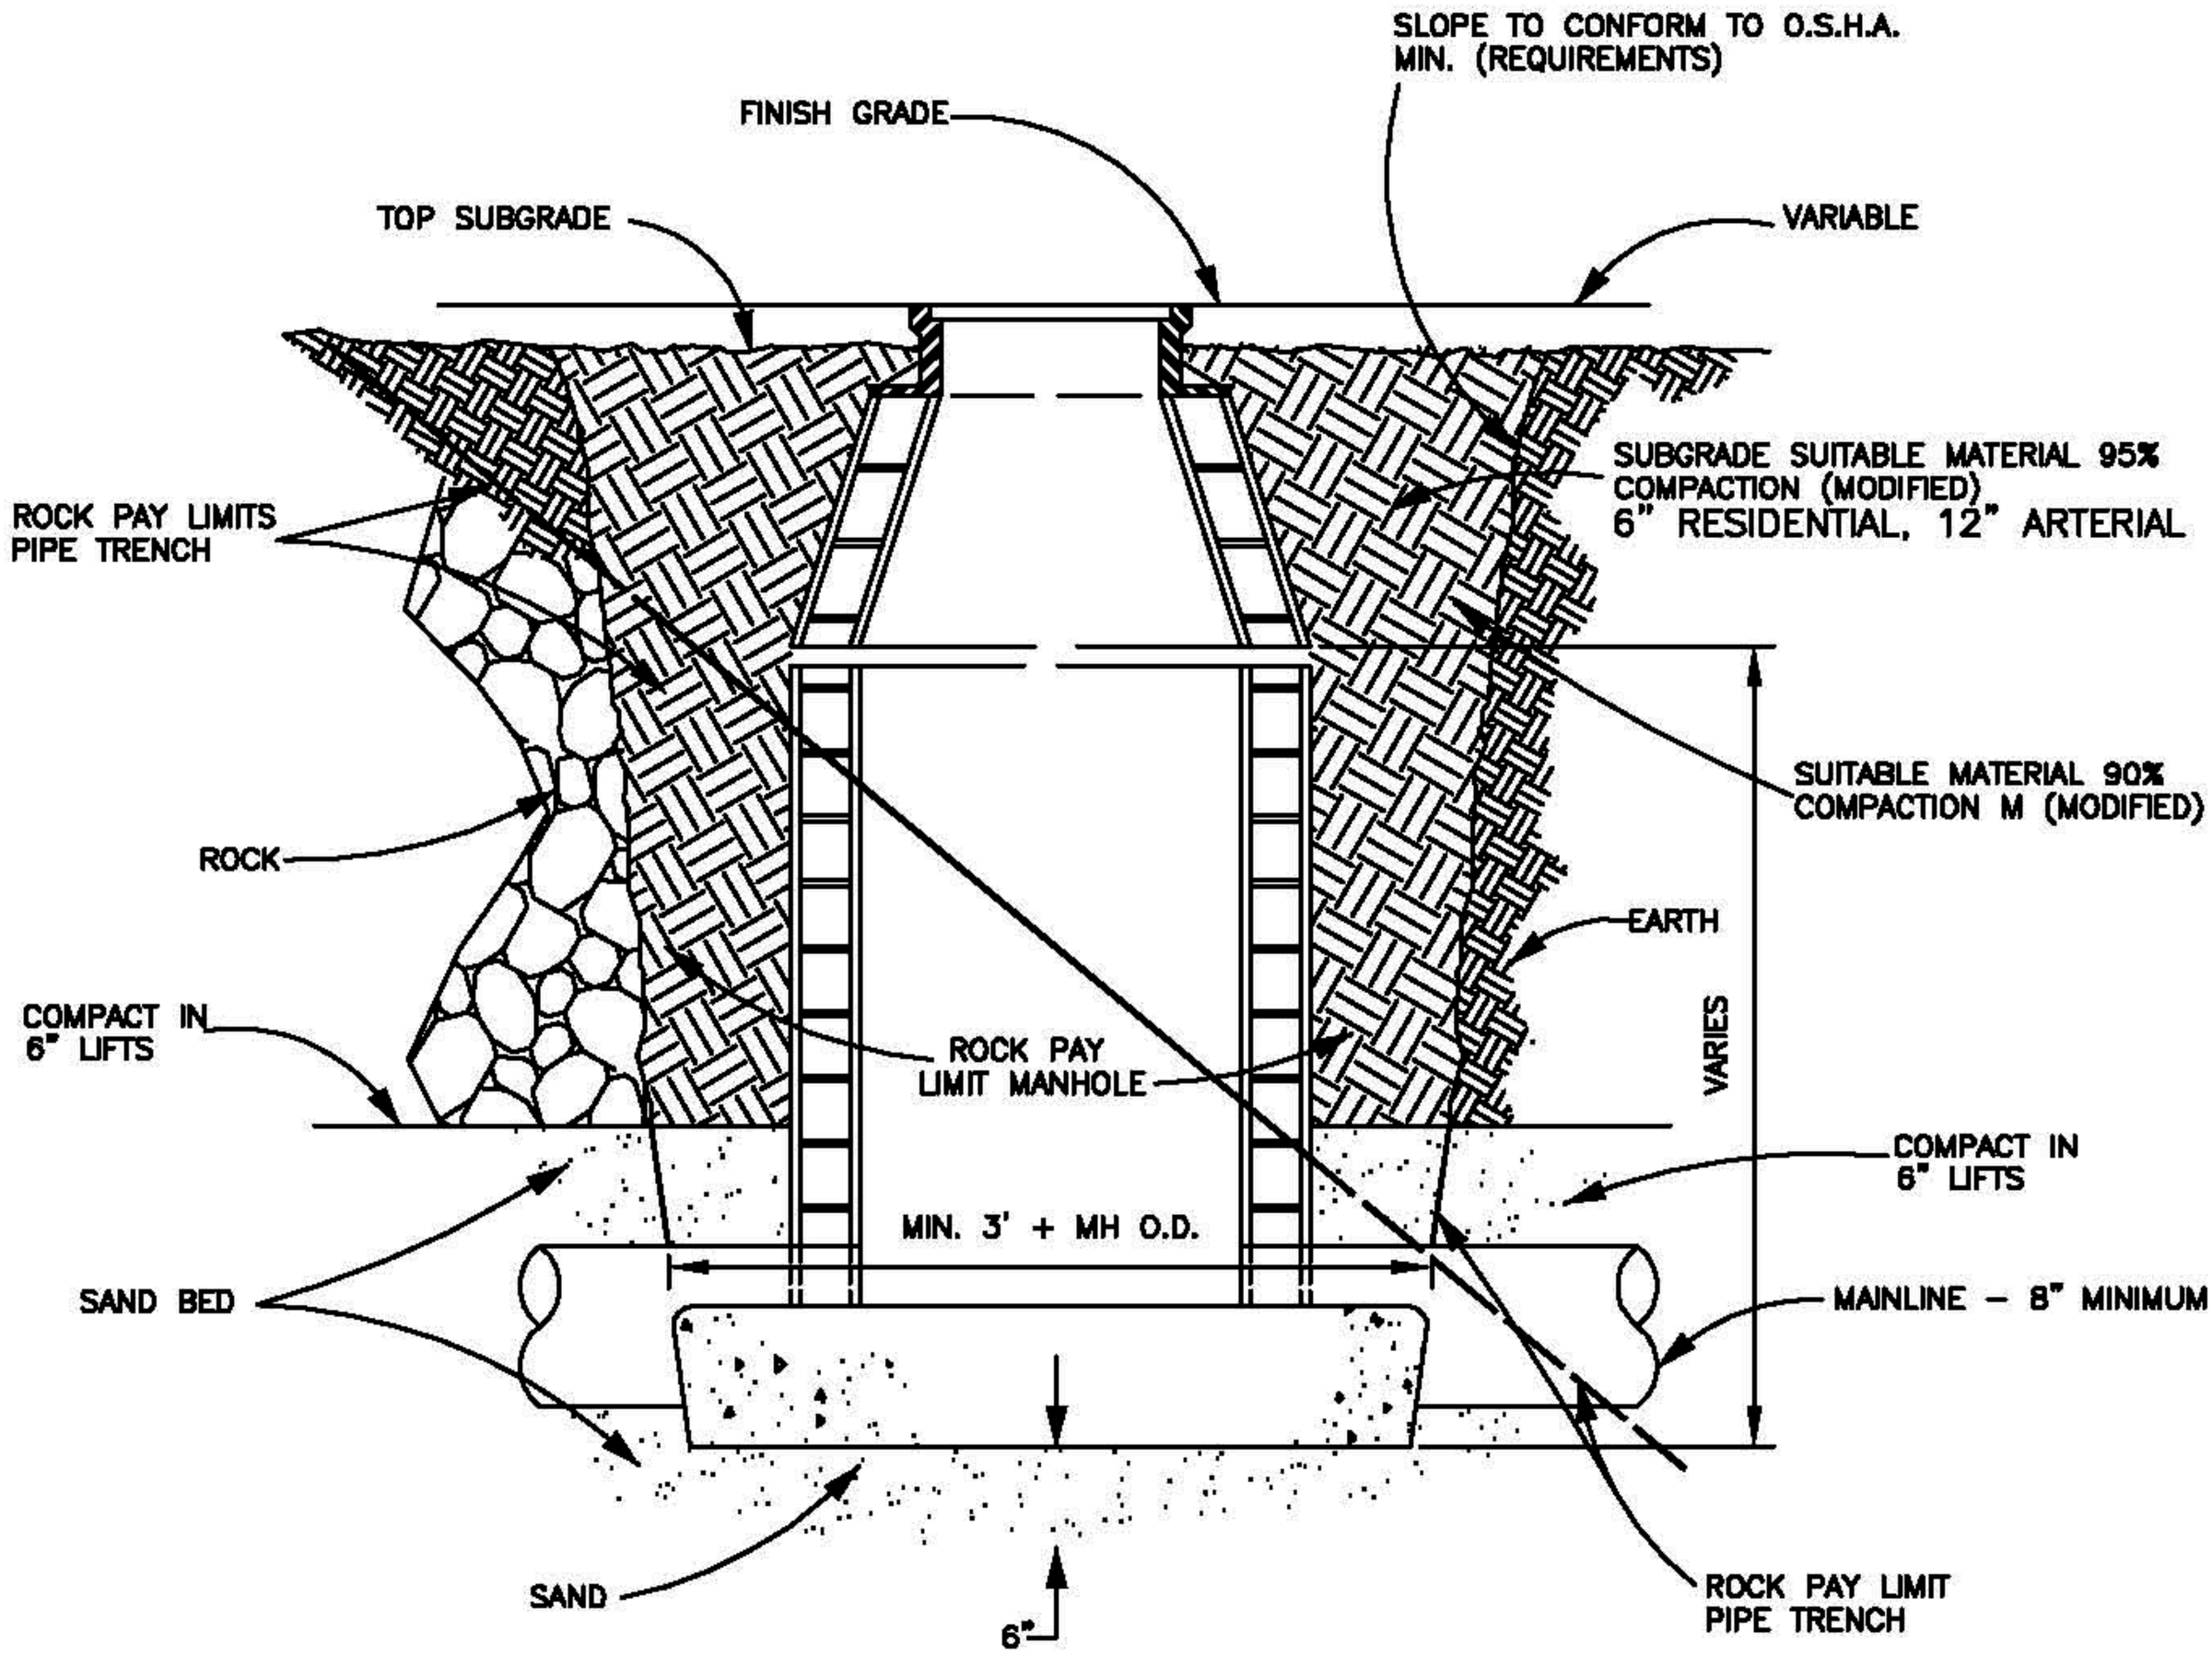

NOTE:

AS DETERMINED BY A.S.T.M. D–1557
A.A.S.H.O. DEG T–147–FIELD TEST
MOISTURE CONTENT OF ALL COMPACTION
SUBGRADE MATERIAL IN PLACE SHALL
BE NO GREATER THAN OPTIMUN NOR
ANY LESS THAN OPTIMUM MINUS 5%

CUT AND BACKFILL IN ROCK
FOR MANHOLES

CONSTRUCTION STANDARDS	TRENCH CUTS (MANHOLES) TRENCH WIDTHS STANDARD No. D–111 SHEET 1 OF 1	CITY OF AZTEC PUBLIC WORKS DEPARTMENT