


PAVEMENT SECTION
MINIMUM

NOTES

- 1) CROWN ON STREETS LESS THAN 40' TO BE AT A 2% SLOPE UNLESS OTHERWISE SPECIFIED.
- 2) ALL SUBGRADE COMPACTION FOR C & G WILL EXTEND 12" MIN. ON EITHER SIDE OF CURB AND GUTTER.
- 3) POOR SUBGRADE MAY REQUIRE ADDITIONAL SOIL MATERIAL AND/OR MATING MATERIAL. APPROVAL BY THE CITY ENGINEER REQUIRED.
- 4) SUBGRADE PREPARATION UNDER SIDEWALK AND DRIVEPADS SHALL BE INCLUDED WITH THE PARTICULAR ITEM.
- (2)5) BASE COURSE UNDER CURB & GUTTER MINIMUM 3" THICK.
- (2)6) FINAL PAVEMENT SECTION TO BE DESIGNED BY A GEOTECHNICAL ENGINEER.

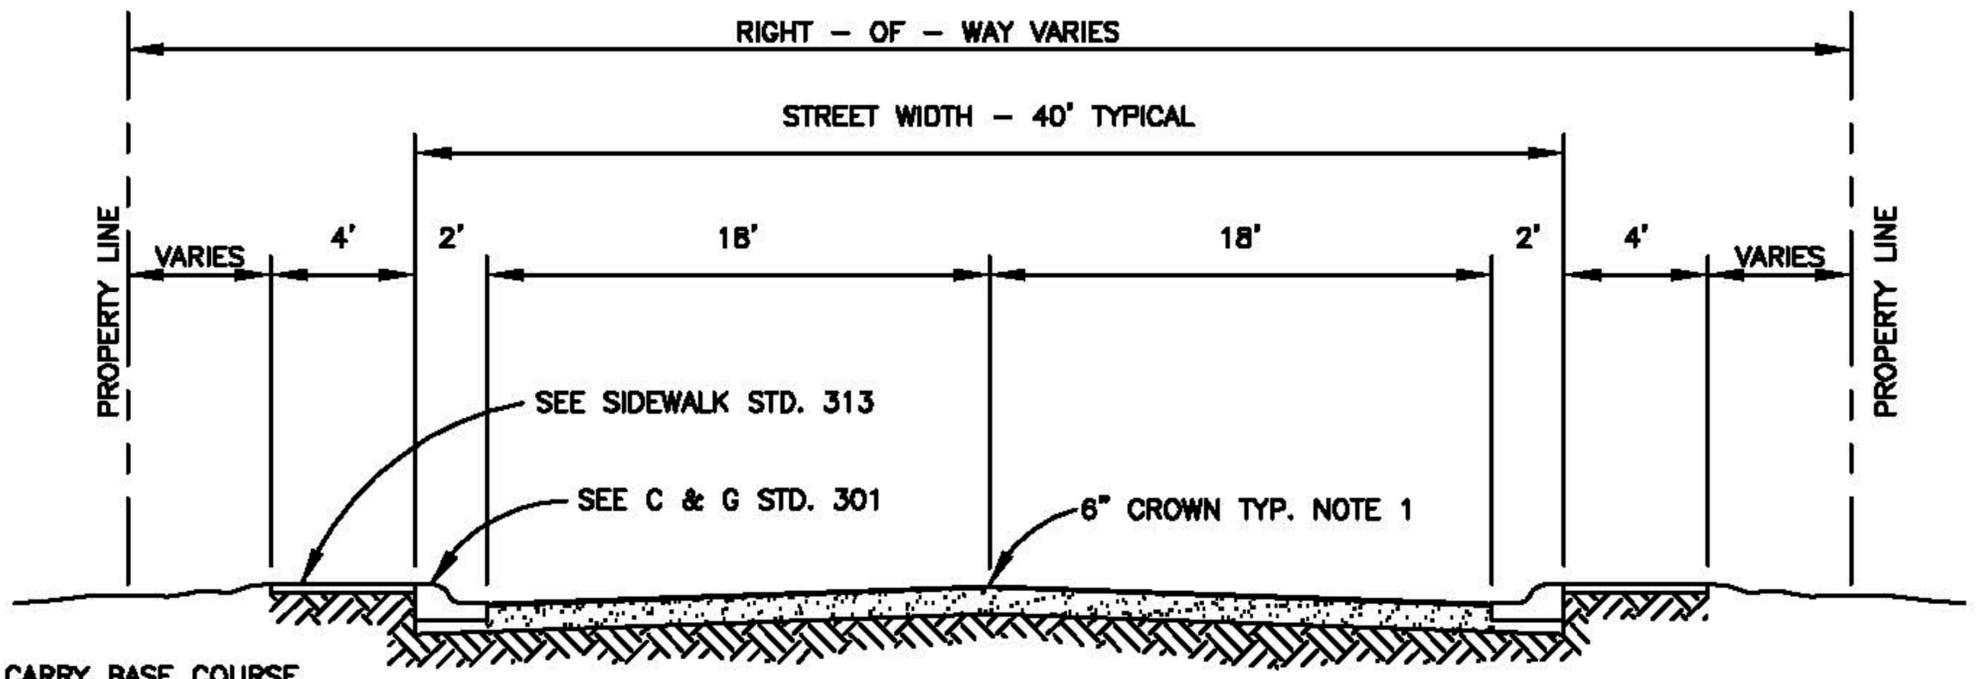

TYPICAL RESIDENTIAL STREET SECTION

REV.	DATE
1	7/20/90
(2)	12/15/94
(3)	01/02/01

CONSTRUCTION
STANDARDS

PAVING
RESIDENTIAL STREET

STANDARD No. D-319 SHEET 1 OF 1

CITY OF
AZTEC
PUBLIC WORKS
DEPARTMENT