


### EARTH TO ROCK LONGITUDINAL TRANSITION

ANY MODIFICATIONS OR  
CHANGES SHALL BE  
APPROVED AT THE DIRECTION  
OF THE CITY ENGINEER

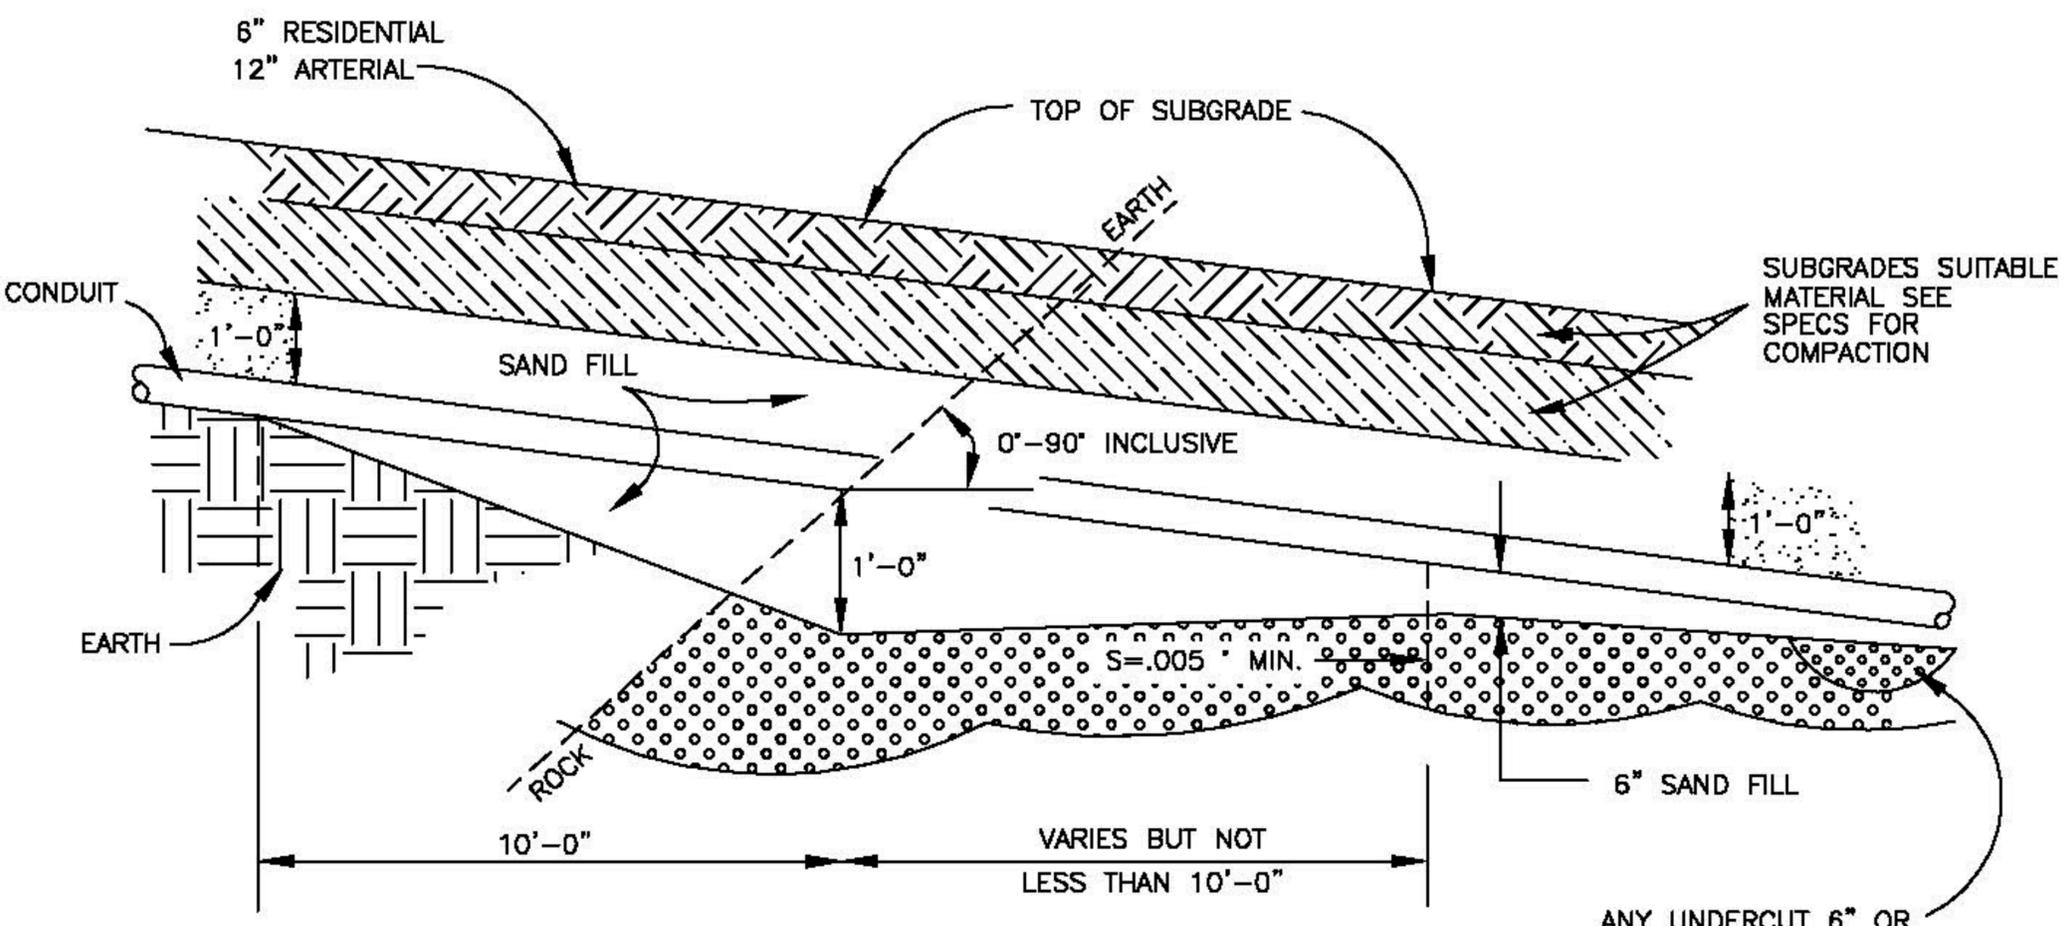

**NOTES**

AS DETERMINED BY A.S.T.M. D.-1557  
A.A.S.H.O. DEG, T-147-FIELD TEST  
MOISTURE CONTENT OF ALL COMPACTED  
SUBGRADE MATERIAL IN PLACE SHALL  
BE NO GREATER THAN OPTIMUM NOR  
ANY LESS THAN OPTIMUM MINUS 5%

ANY UNDERCUT 6" OR  
OVER TO BE FILLED  
WITH 1 1/2" STONE

### EARTH TO ROCK LONGITUDINAL TRANSITION

CONSTRUCTION  
STANDARDS

## PIPELINE INSTALLATION IN ROCK AREAS

STANDARD NO. D-405 SHEET 1 OF 1

CITY OF  
AZTEC  
PUBLIC WORKS  
DEPARTMENT