


CLASS "A"
 (CONCRETE CRADLE)
 L.F. = 2.8

CLASS "B"
 (GRANULAR BASE)
 L.F. = 1.9

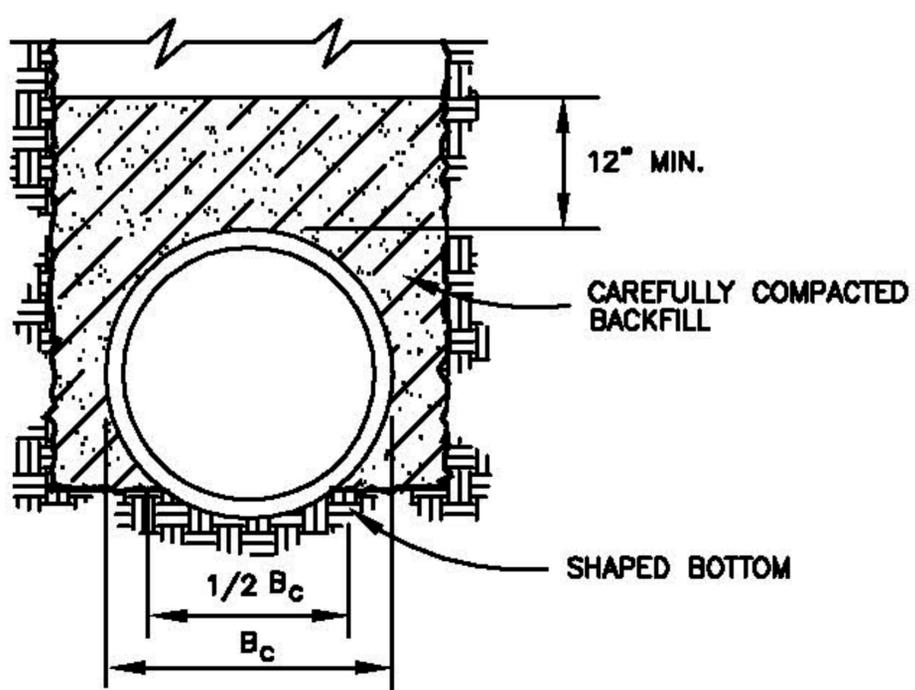

CLASS "C"
 (SHAPED BOTTOM)
 L.F. = 1.5

NOTES

- FOR ROCK OR OTHER INCOMPRESSIBLE MATERIALS, THE TRENCH SHALL BE OVEREXCAVATED A MINIMUM OF 6" AND REFILLED WITH GRANULAR BEDDING MATERIAL AS DEFINED BY CLASS "B" BEDDING.
- "L.F." LOAD FACTOR.



REV.	DATE
1	01/31/06