



GENERAL NOTES

- △1) CONCRETE TO BE 3,000 PSI 28 DAY STRENGTH.
- 2) WALLS & FLOOR TO BE 6" THICK IF BOX IS 4' DEEP OR LESS. 8" THICK IF BOX IS 4' TO 7' DEEP.
- △3) PIPE OUTLET 18" DIA. MIN.
- △4) CULVERTS UNDER PUBLIC STREETS SHALL BE RCP OR OTHER NON-FERRIS PIPE WITH CITY ENGINEERS APPROVAL.

CATCH BASIN FRAME & LID NEENAH R-3313 OR △ R-3317 OR CITY APPROVED EQUAL

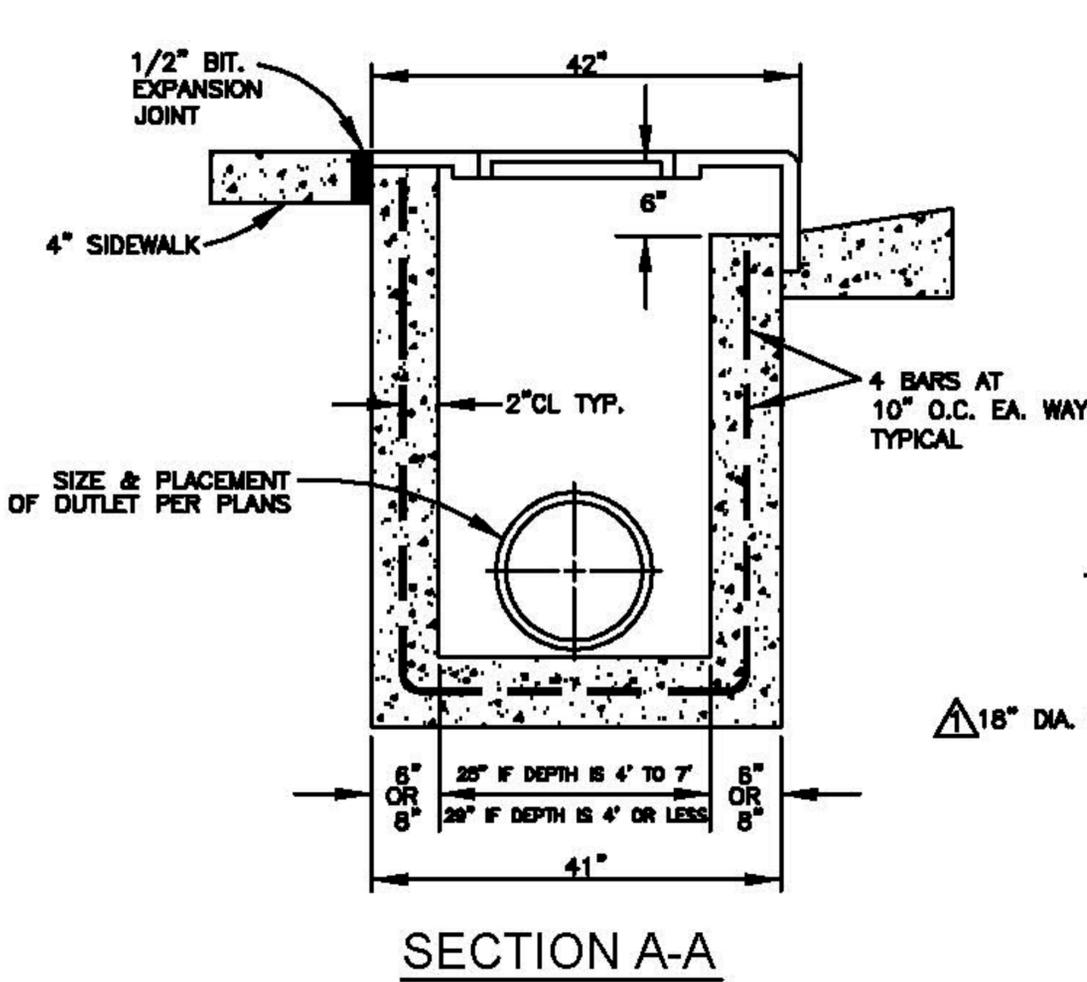

SECTION A-A

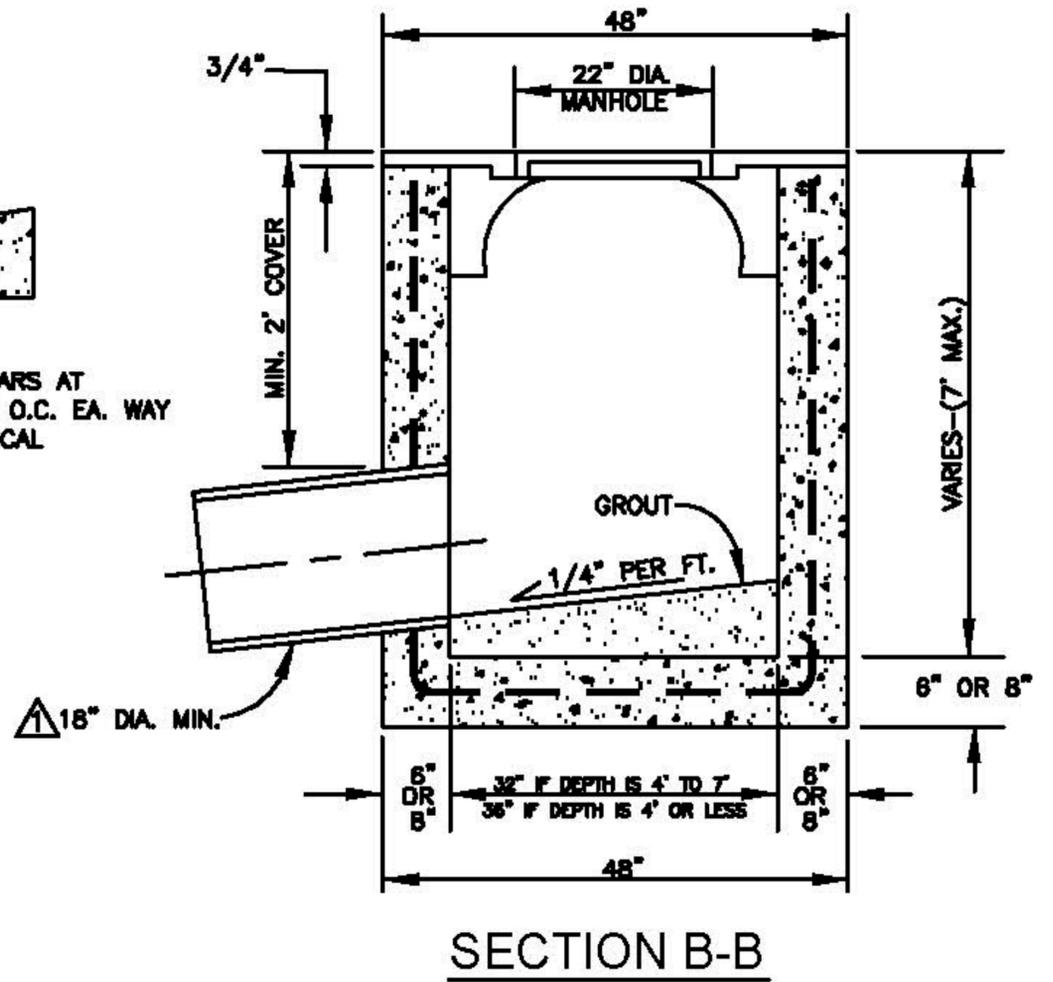

SECTION B-B

| REV. | DATE |
|------|----------|
| △1 | 3/1/96 |
| △2 | 01/07/04 |
| △3 | 11/30/05 |

CONSTRUCTION STANDARDS

BEHIND-THE-CURB CATCH BASIN AND CURB INLET

STANDARD No. D-507 SHEET 1 OF 1

CITY OF
AZTEC
PUBLIC WORKS
DEPARTMENT