


GENERAL NOTES

1. THE CITY DOES NOT ACCEPT RESPONSIBILITY FOR MAINTENANCE OF ANY DRAIN LINES INSTALLED BY OR FOR PRIVATE PROPERTY OWNERS.
2. CORE DRILL INTO BACK OF EXISTING CATCH BASIN WITH INVERT OF DRILLED OPENING $1/2"$ ABOVE EXISTING CONC. GROUT WITH NONSHRINK, NONMETALLIC GROUT.
- △ 3. NEW DRAIN LINE TO BE SCH. 40 PVC, RCP, DUCTILE IRON PIPE, OR ADS N-12 HDPE. DRAIN SIZE TO BE AT LEAST ONE SIZE SMALLER THAN OUTLET PIPE WITH A MAXIMUM SIZE OF $12"$.

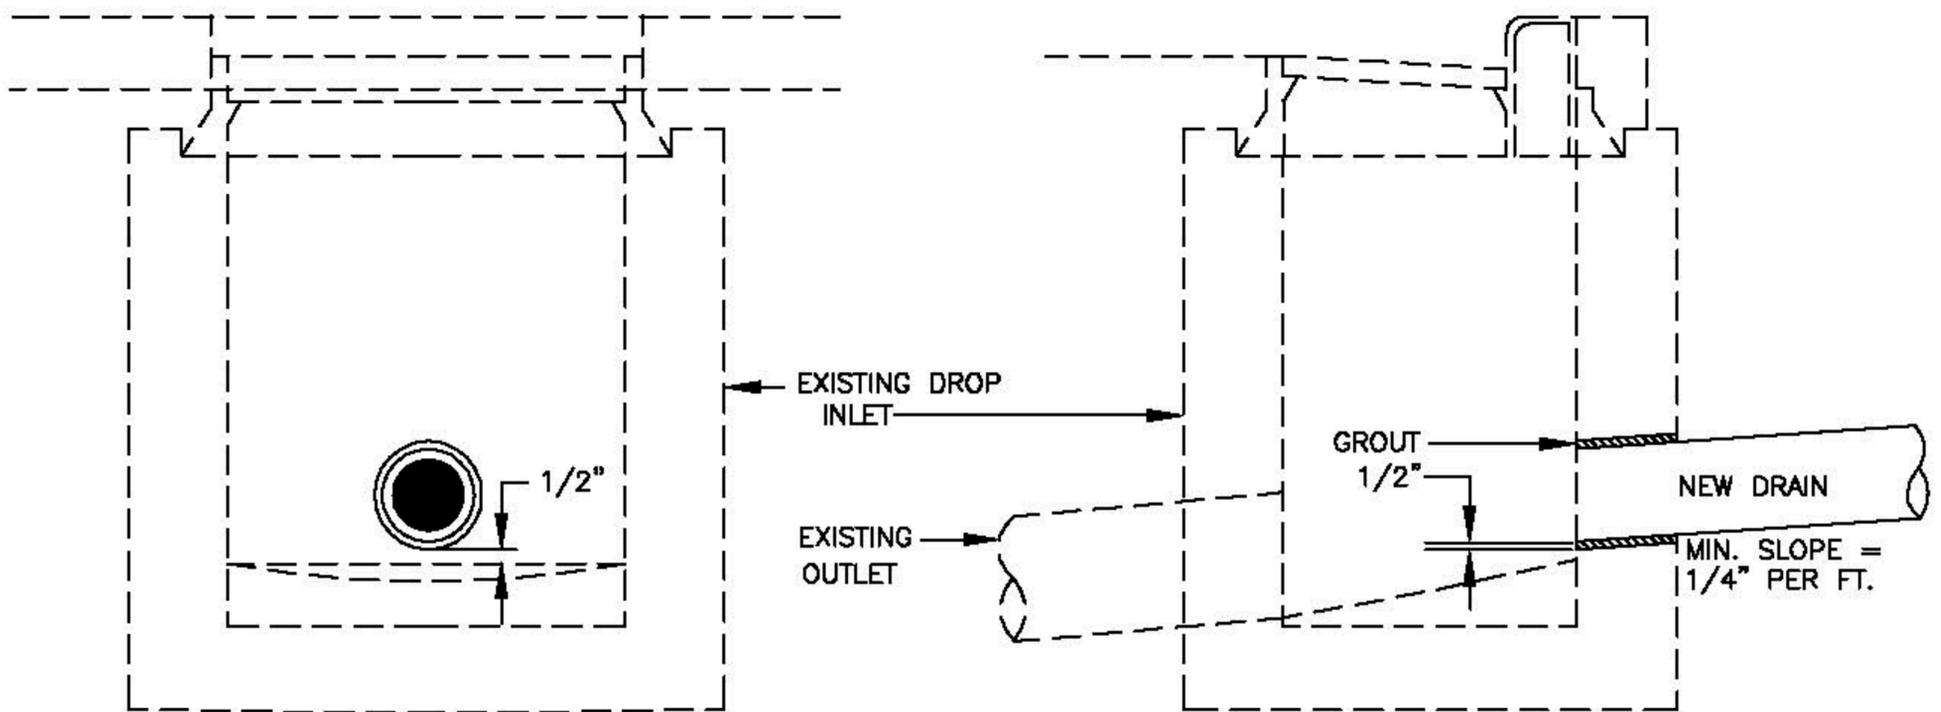

TYPICAL SECTIONS THRU DROP INLET

REV.	DATE
△	12/16/04

**CONSTRUCTION
STANDARDS**

DRAIN LINE CONNECTION TO EXISTING DROP INLET

STANDARD No. D-509 SHEET 1 OF 1

**CITY OF
AZTEC**

**PUBLIC WORKS
DEPARTMENT**