


**NOTE:**

1. ALL IMPROVEMENTS MUST DRAIN AWAY FROM THE HOUSE TO STREET, DRAINAGE EASEMENT OR DETENTION POND.
2. FINISHED FLOOR ELEVATION MUST BE A MINIMUM OF 18" ABOVE THE FLOW LINE OF THE GUTTER AT LOW SIDE OF LOT.
3. IF CURB & GUTTER ARE ABSENT FLOWLINE IS AT THE EDGE OF ROADWAY AT LOW SIDE OF LOT.

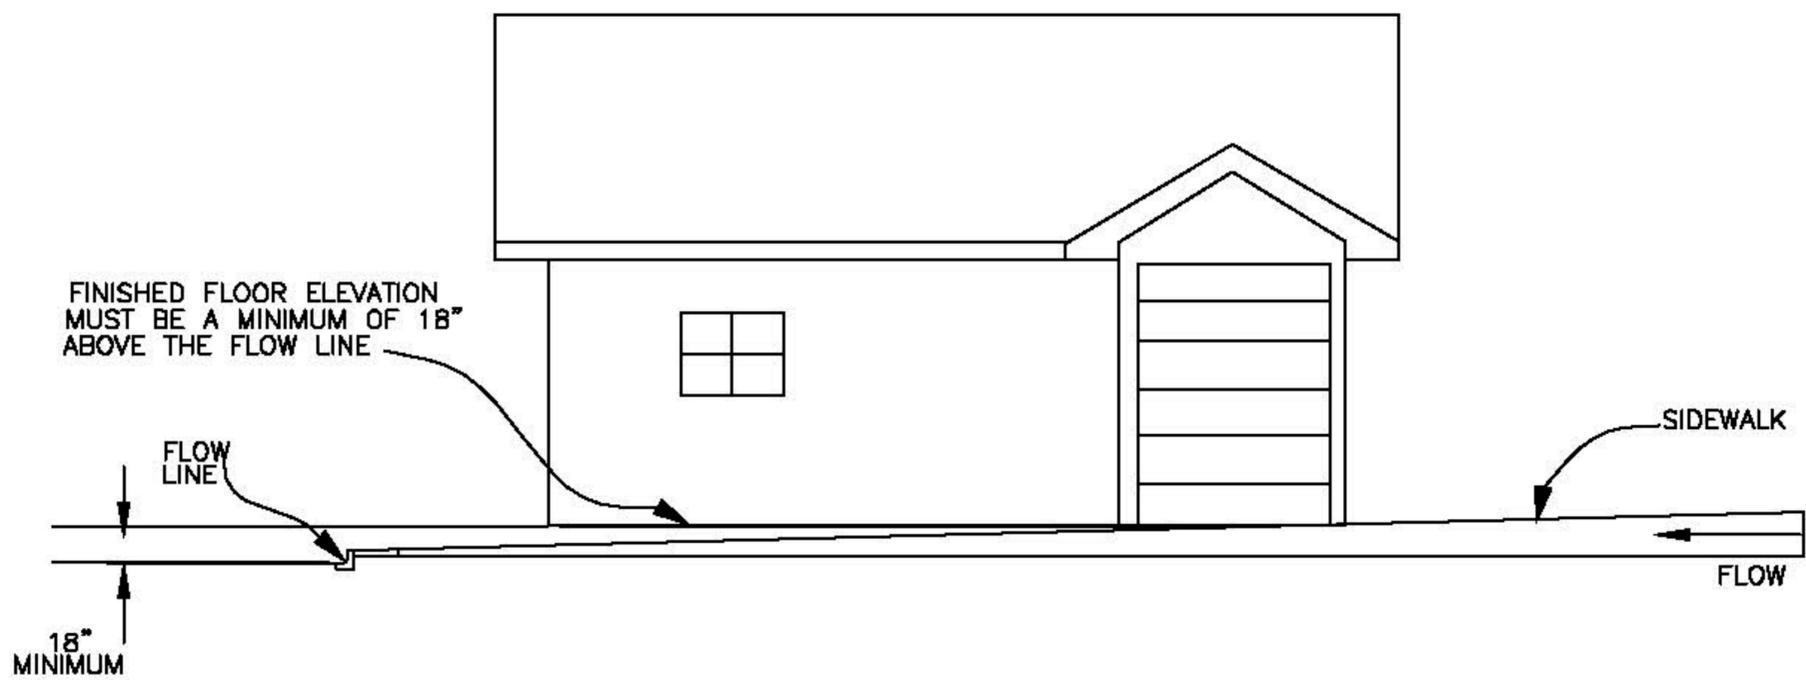

**CONSTRUCTION  
STANDARDS**

**ELEVATION RESIDENTIAL  
DRAINAGE**

STANDARD No. D-612 SHEET 1 OF 1

**CITY OF  
AZTEC**  
**PUBLIC WORKS  
DEPARTMENT**