



FIRE HYDRANT W/O INTEGRAL STORZ	
MANUFACTURER	MODEL
M&H	129
MUELLER	A423/A425
KENNEDY	K-81D
CLOW	F2545

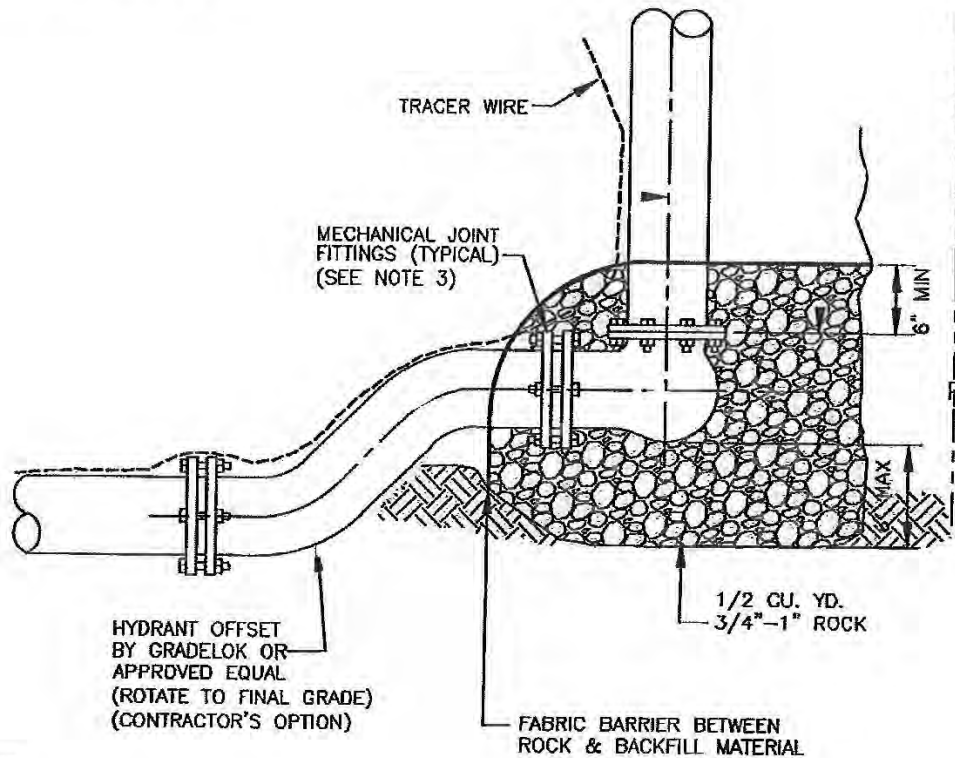

NOTES:

1. ORIENTATION OF NOZZLES AS SPECIFIED.
2. BURY 6" or 8" PIPE.
3. TWO RESTRAINED 45 BENDS (EQUIVALENT TO PIPE SIZE) MAY BE INSTALLED IN LIEU OF THE SWIVEL OPTION.



**STANDARD OR DOUBLE
FIRE HYDRANT (OPTIONAL OFFSET)**

CONSTRUCTION STANDARDS

STANDARD NO. W-6

SHEET 3 OF 7

APP'D R. Salcido
DATE Oct. 11, 2023